


**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting – 320 AMP Service**

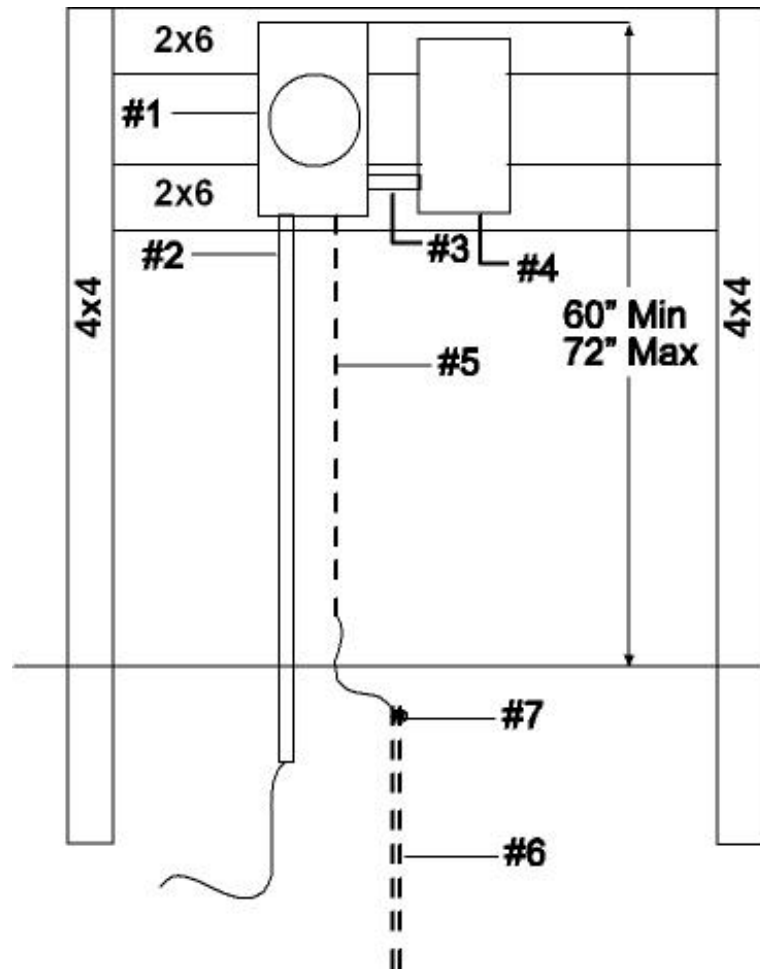

1. Meter Can
  2. Schedule 80 electrical grade PVC (supplied by SPEC if requested)
  3. Threaded galvanized nipple (MUST be minimum size of 2 ½"). Length must be a minimum of 4" but not more than 6". Lock rings are required on all nipples and adapters. It is preferred that insulation bushings be used to protect the conductors.
  4. Breaker Box (with breakers inside)
  5. #2 copper wire (min.) for ground. Must be in conduit (PVC or EMT).
  6. 5/8" X 8' copper weld ground rod
  7. Copper weld ground rod clamp.
- A. Minimum size #2 copper ground wire must be installed between the meter can and the breaker box.
  - B. SERVICE CONDUCTOR FEEDERS are connected to the TOPSIDE lugs in the meter can. LOAD SIDE CONDUCTORS to the breaker box are connected to the BOTTOM lugs in the meter can.
  - C. Wire should be sized according to load. See chart on back.
  - D. Conduit should be sized according to wire size. See chart on back.
  - E. Item #3: If meter pole is used: offset galvanized nipples, LB's and metal flex conduit may be used.

METER LOOPS MUST BE COMPLETELY ASSEMBLED BY THE MEMBER OR BY AN ELECTRICIAN IN ORDER TO BE CONNECTED. Co-op employees will not help in the assembling of a meter loop on the job site.

**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting – 320 AMP Service**

SPEC has a licensed electrician that builds meter loops and offers other services as well. For a price quote please call the Cooperative at 361-364-2220.

**CONSTRUCTION of a 3 WIRE METER LOOP**

Meter loop must be assembled and installed by the member or an electrician. The Coop shall determine the acceptability of the meter loop before the connection is made.

Meter Can must be mounted a MINIMUM of 60” from the ground up and a MAXIMUM of 72” from the ground up. This applies to House & Meter Pole installation. Meter Poles must be a minimum of 9’ in length and must be set 3’ deep in the ground.

Meter and main disconnect must be located on the outside area of any structure and must be accessible to the Cooperative. Disconnect must be located directly beside the meter can. Disconnect must be breakers or fuses. **BLADED DISCONNECT SWITCHES ARE NOT ALLOWED.**

Meter loop shall be made of Schedule 80 electrical grade PVC. EMT is not acceptable

Meter loop must be wired with copper wire from the load side of the meter can to the breaker box.

**\*ALLOWABLE AMPERAGE OF AN INSULATED CONDUCTOR**  
**Taken from National Electric Code Manual Table 310-15B**

Copper wire, type THHN maximum temp. 90° centigrade, 600 Volt insulation minimum.

<b>WIRE SIZE</b>			<b>**CONDUIT SIZE</b>
#6 Cu.	75 amps (min. size allowable)	Per Wire	1”
#4 Cu.	95 amps	Per Wire	1”
#2 Cu.	130 amps	Per Wire	1 ¼”
1/0 Cu.	170 amps	Per Wire	1 ½”
2/0 Cu.	200 amps	Per Wire	2”
3/0 Cu.	225 amps	Per Wire	2”
4/0 Cu.	260 amps	Per Wire	2”
350 mcm	320 amps	Per Wire	2 ½” - 3”

Consumers may dig their own trench. Charges are still involved. San Patricio Electric Co-op. **MUST** be contacted **BEFORE** work is done. Call for information on prices, specifications, contractor insurance requirements, scheduling, etc.

Caution must be taken in selecting the service entrance location to the meter. Cable is buried in conduit. Sharp turns and angles can not be made.

**San Patricio Electric has an electrician that builds meter loops.**  
**For price quotes call the Cooperative at 361-364-2220.**