


San Patricio Electric Cooperative, Inc. Double Throw Switch Installation

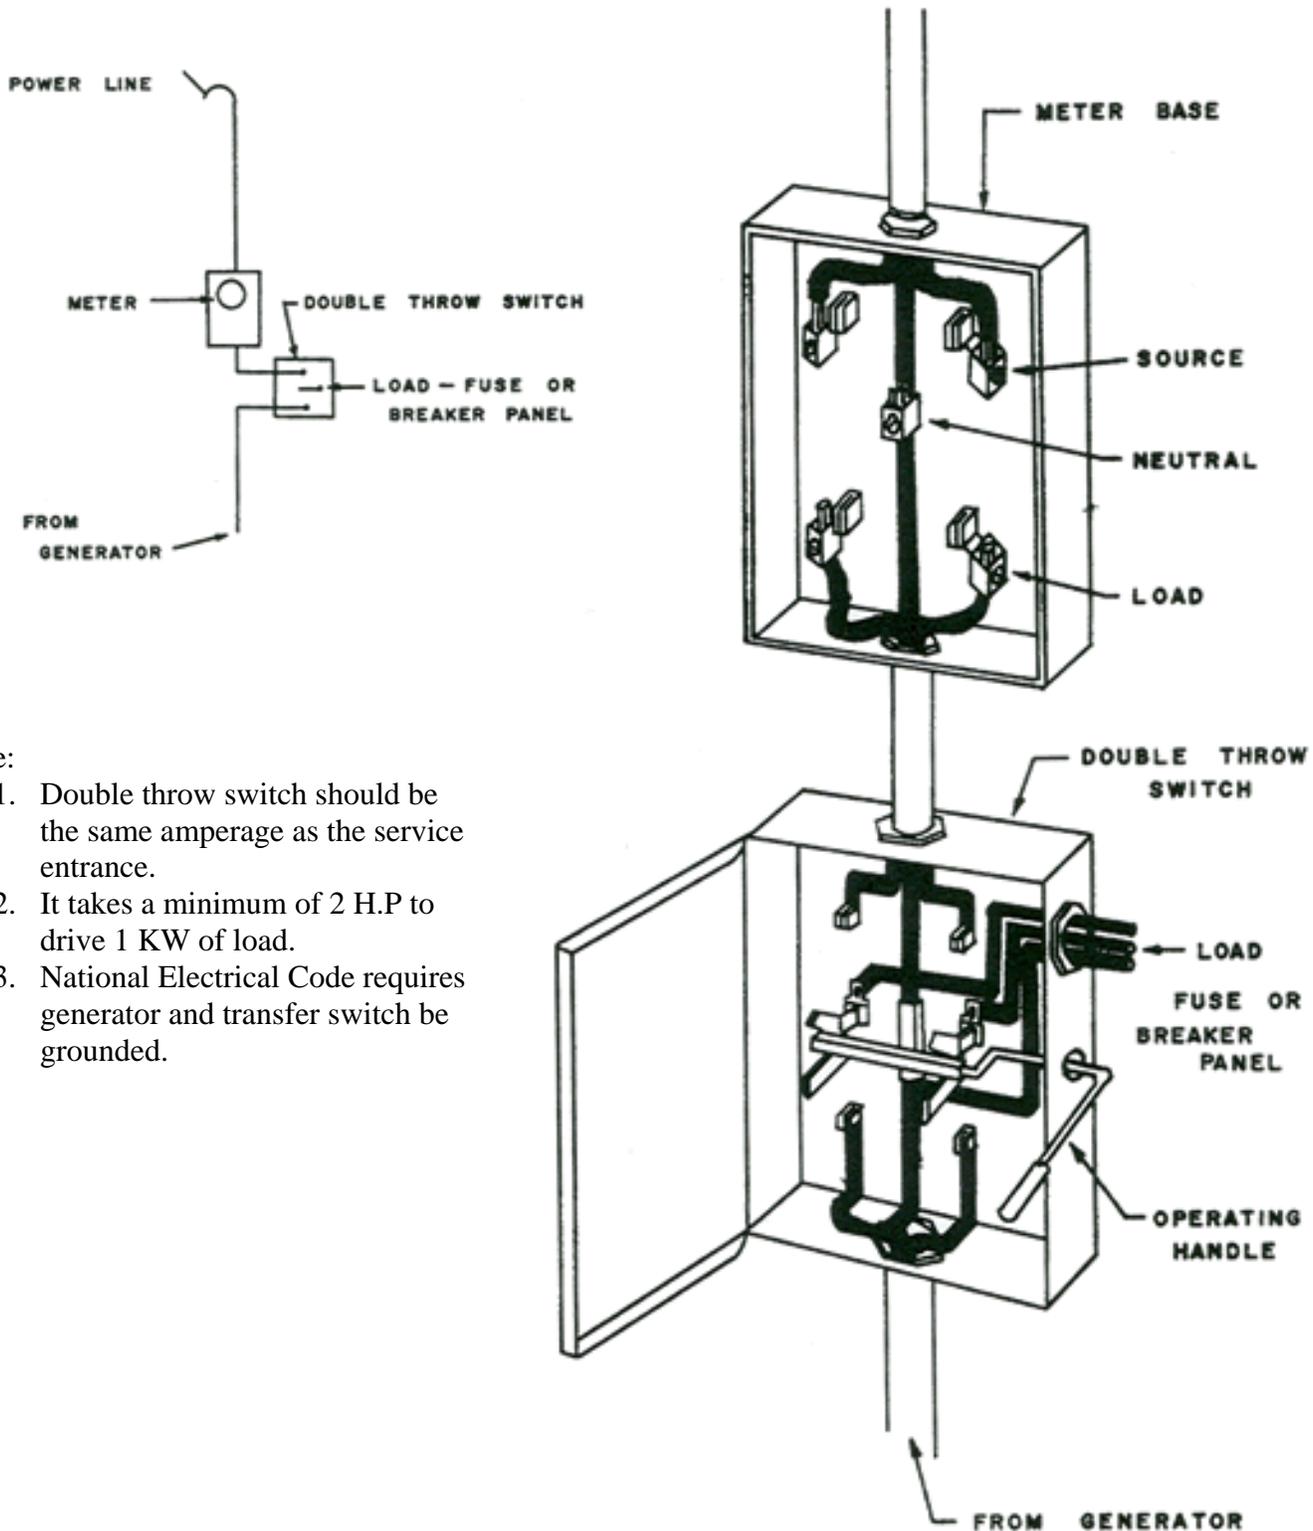

Note:

1. Double throw switch should be the same amperage as the service entrance.
2. It takes a minimum of 2 H.P to drive 1 KW of load.
3. National Electrical Code requires generator and transfer switch be grounded.